


TYPICAL ARRANGEMENT OF DUCT ENTRANCES.
DUCTS MAY ENTER THE PULL BOX AT ANY ANGLE
OR LOCATION AT THE SPECIFIED DEPTH AND
SHOULD BE APPROXIMATELY 150 mm ABOVE THE FLOOR
OF THE PULL BOX.

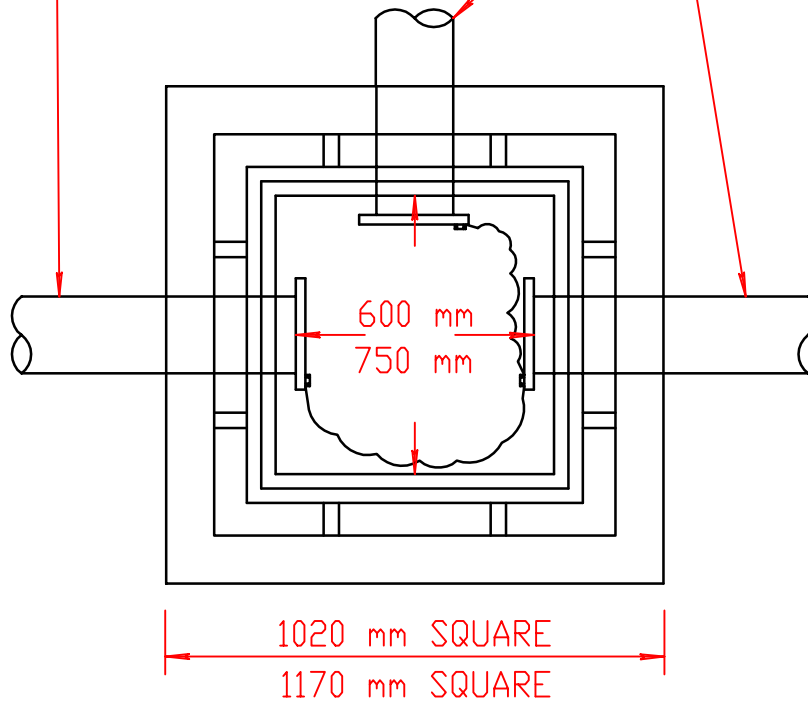

PLAN

NOTE

THE BUSHING SHALL BE INSULATED AND HAVE A GROUND LUG FOR #6 COPPER WIRE. ALL CONDUITS SHALL BE WIRED/GROUNDED TOGETHER WITH THE BARE #6 COPPER WIRE.

PULL BOX DETAIL

NOT TO SCALE

7/14/00

REVISED